

1,500 GALLON HS-20 SEPTIC TANK



TANK DESIGN SPECIFICATIONS
CONFORMS TO LATEST:
ASTM DESIGNATION C1227

NOTES:

1. JOINT SEALANT IS BUTYL RUBBER MASTIC TYPE SEAL THAT CONFORMS TO LATEST AASHTO SPEC. M-198.
4. REINFORCING STEEL DEFORMED BARS CONFORM TO LATEST ASTM SPEC. A706, GRADE 60, COVER $1\frac{1}{2}$ " UNLESS NOTES.
5. CONCRETE COMPRESSIVE STRENGTH-5,000 PSI AT 28 DAYS SELF CONSOLIDATING CONCRETE.
6. METHOD OF MANUFACTURE: WET CAST.
7. BOTTOM SECTION IS MONOLITHIC.
8. DESIGNED FOR AASHTO HS-20 LOADING WITH 6" to 60" OF SOIL COVER.
9. ALL PIPING PROVIDED AND INSTALLED BY CONTRACTOR.
10. LIFTING - LIFTING LOOPS IN ROOF SLING LIFTING NOTCHED IN BASE SECTION

WEIGHT CHART

PRODUCT	APPROX. WEIGHT
TANK W/BAFFLE	27,000 LBS.

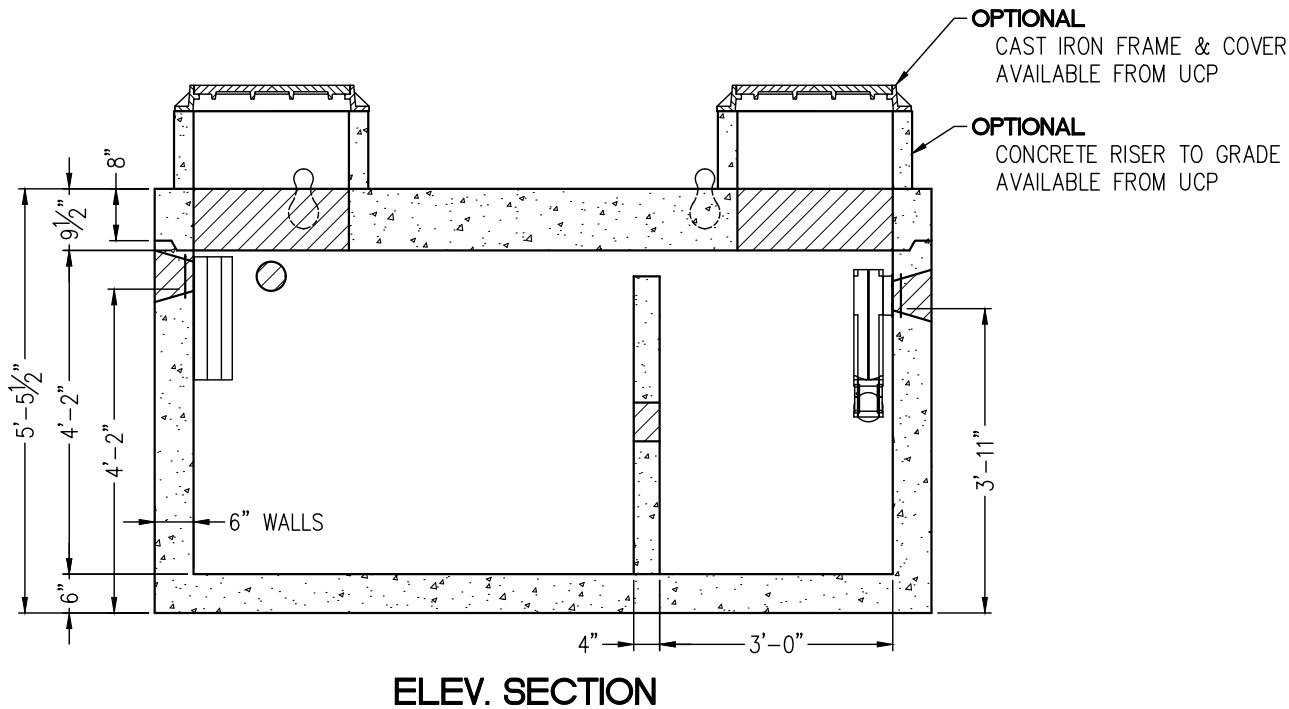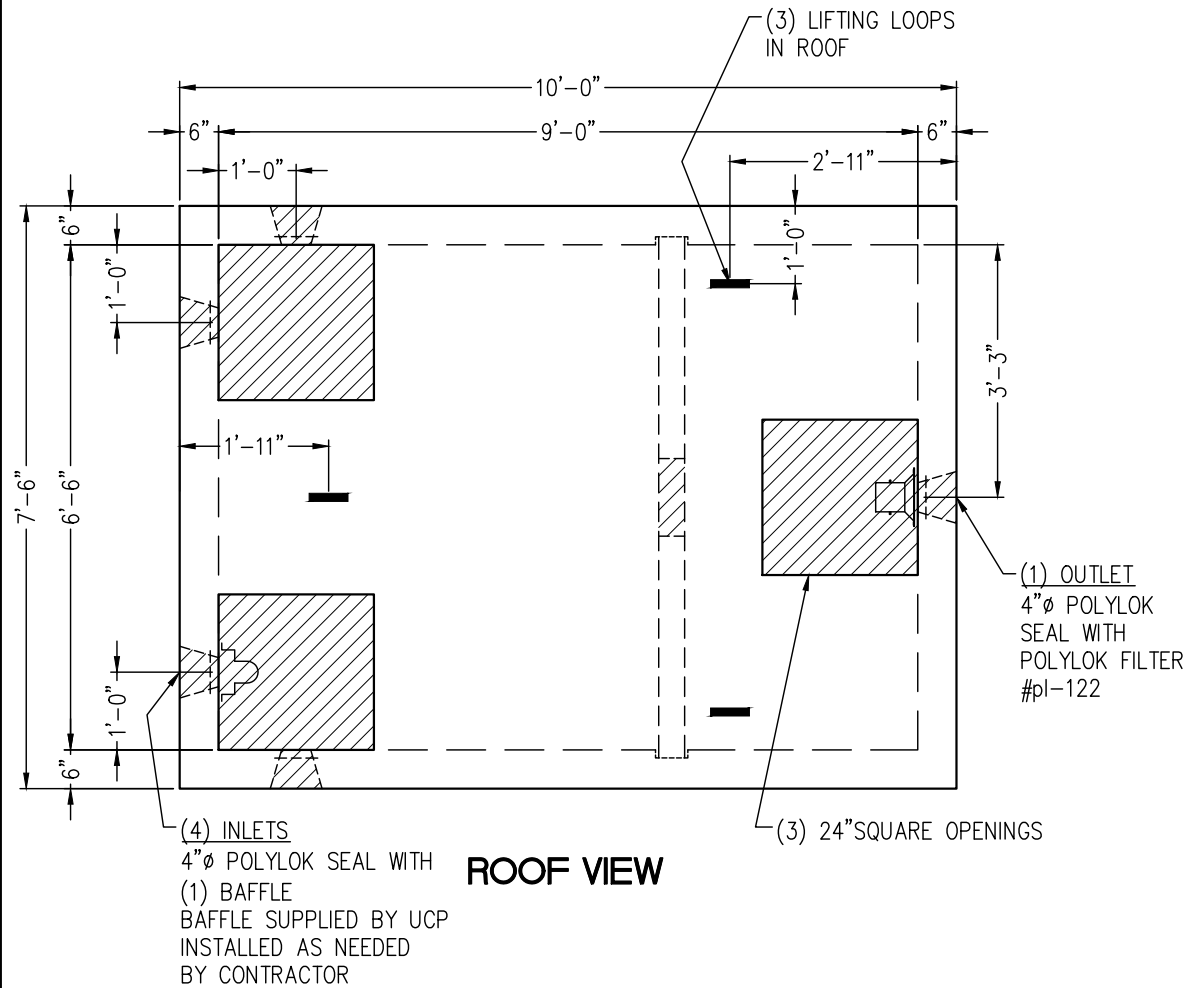

UNITED CONCRETE PRODUCTS INC.

173 CHURCH STREET
YALESVILLE, CT 06492

TEL. (800) 234-3119
TEL. (203) 269-3119

FAX. (203) 265-4941
WWW.UNITEDCONCRETE.COM