


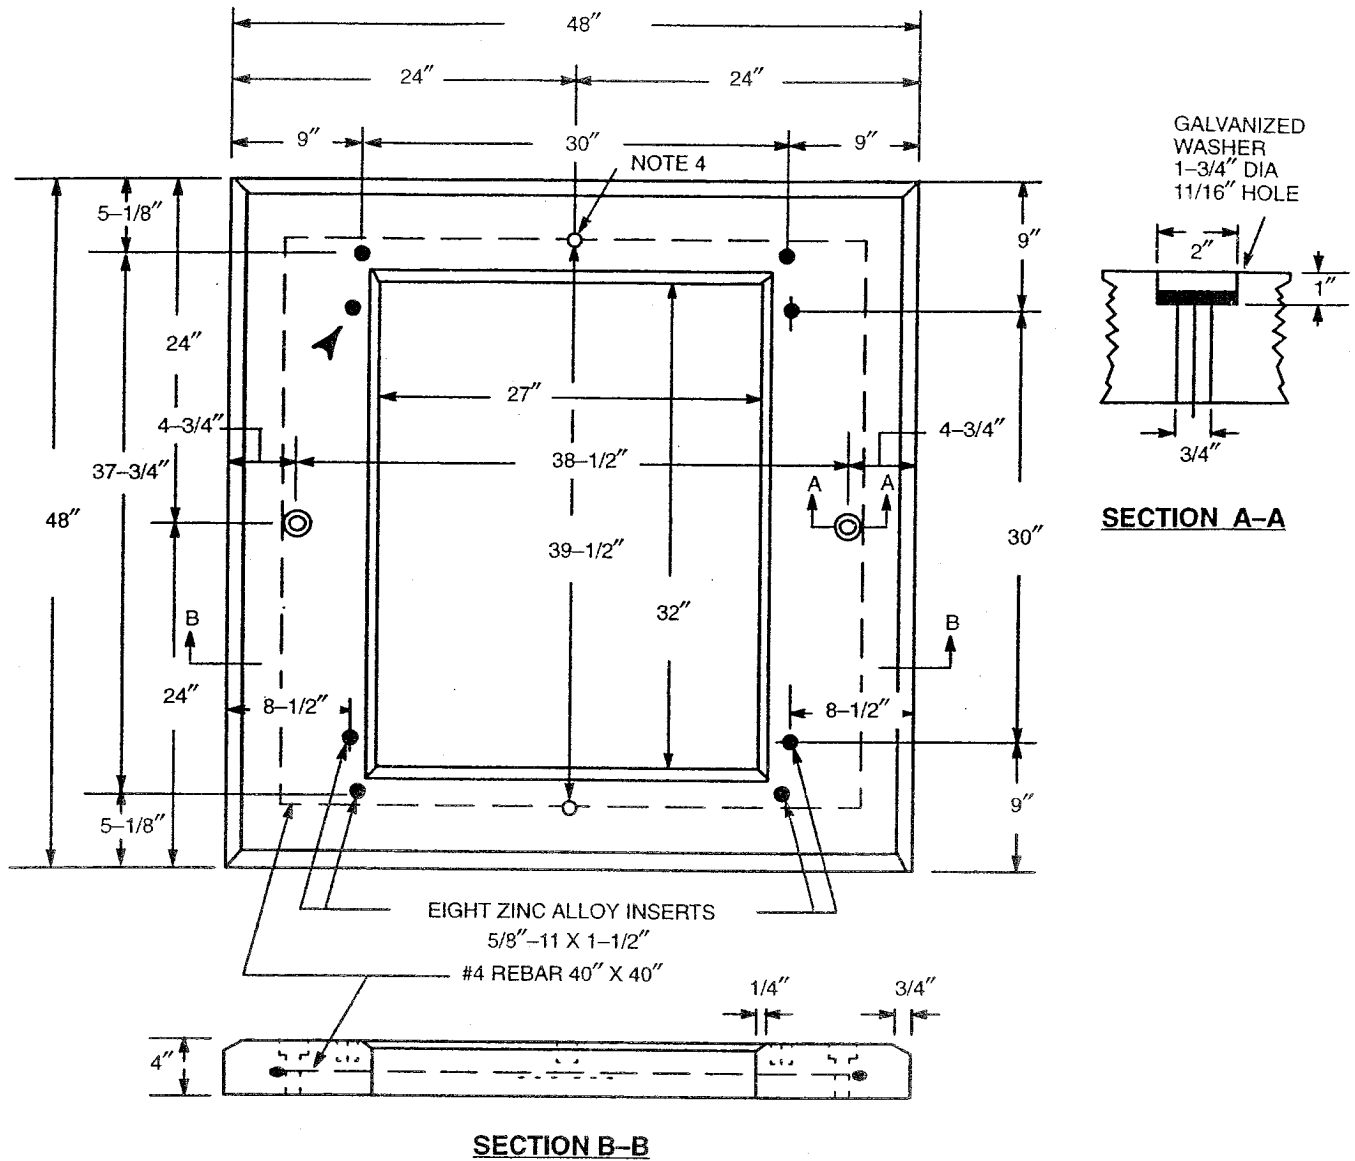

NOTES

1. Final 28 day concrete strength to be 5000 psi.
2. Manufacturer's identification and month/year when manufactured shall be legibly marked in/on concrete in the top within 4 inches of the opening.
3. Concrete and concrete design shall be in accordance with ACI 318-1986.
4. Two 3/4 inch coil loop inserts (Dayton F63) with an insert locator plug (Dayton T21) for lifting the pad with a swivel plate.

ORIGINAL	PAD – ENCLOSURE – PRECAST CONCRETE			
2/17/76				
APPROVED	48" X 48" X 4"			
11/1/94				
FGH	NORTHEAST UTILITIES	MATERIAL SPECIFICATION	SPC P-017	9