
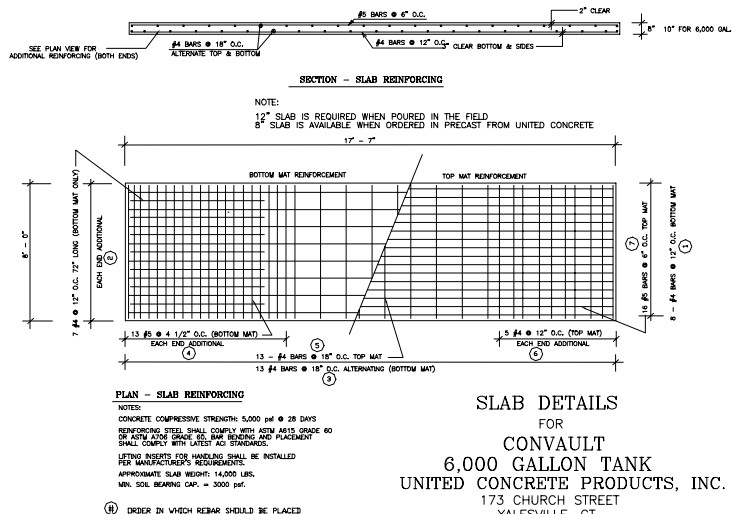
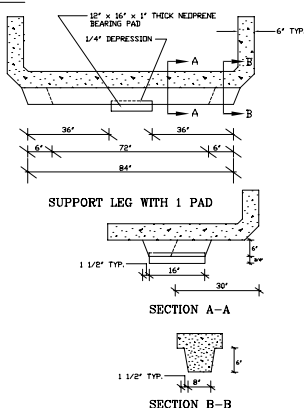

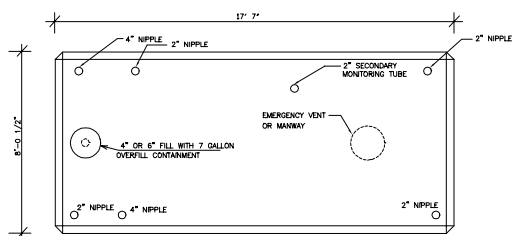


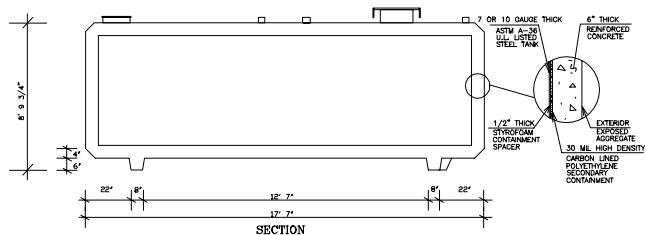

SLAB DETAILS
FOR
CONVAULT
6,000 GALLON TANK
UNITED CONCRETE PRODUCTS, INC.
173 CHURCH STREET
YALESVILLE, CT
(203) 269-3119
(203) 265-4941 FAX

GENERAL NOTES:

STEEL TANK SHALL BE U.L. LISTED FOR ABOVE GROUND
STORAGE OF FLAMMABLE LIQUIDS.

STEEL TANK SKIN SHALL BE 7 OR 10 GAUGE THICK A.S.T.M. A-36
STEEL PLATE.

STEEL TANK AND SECONDARY CONTAINMENT SHALL BE
ENCASED IN 6" OF REINFORCED CONCRETE.
CONCRETE COMPRESSIVE STRENGTH = 5,000 psi @ 28 DAYS

THE VAULT SHALL BE OF A MONOLITHIC (SEAMLESS
AND CONTINUOUS) CONCRETE POUR AND CONTAIN
NO COLD JOINTS OR HEAT SINKS (HEAT TRANSFER
POINTS) ON THE BOTTOM OR SIDES.

THE SECONDARY CONTAINMENT SHALL CONSIST OF
A 30 MIL HIGH-DENSITY CARBON LINED POLYETHYLENE
GEO-MEMBRANE